



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for instructions.

I. General Information for the Month/Year of: Oct / 2023

A. Public Water System (PWS) Information

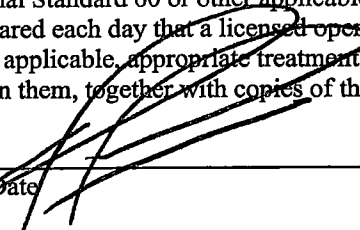
| | | | |
|---|--|--|-------------------------------------|
| PWS Name: Colina Bay | | PWS Identification Number: 3354969 | |
| PWS Type: <input checked="" type="checkbox"/> Community <input type="checkbox"/> Non-Transient Non-Community <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive <input type="checkbox"/> Limited Use System <input type="checkbox"/> Other | | | |
| Number of Service Connections at End of Month: 75 | | Total Population Served at End of Month: 175 | |
| PWS Owner: Colina Recovery, Inc. | | | |
| Contact Person: T. Felton | | Contact Person's Title: Operator | |
| Contact Person's Mailing Address: P.O. Box 491221 | | City: Leesburg | State: Florida Zip Code: 34749-1221 |
| Contact Person's Telephone Number: 352-787-2493 | | Contact Person's Fax Number: 352-326-8756 | |
| Contact Person's E-Mail Address: generalutilities@AOL.com | | | |

B. Water Treatment Plant Information

| Plant Name: Colina Bay | | Plant Telephone Number: 877-275-6374 | | |
|--|----------------|---|---------------------------|------------------------|
| Plant Address: Caravaggio Loop | | City: Montverde | State: FL Zip Code: 34756 | |
| Type of Water Treated by Plant: <input checked="" type="checkbox"/> Raw Ground Water <input type="checkbox"/> Purchased Finished Water | | | | |
| Permitted Maximum Day Operating Capacity of Plant, gallons per day: 115,000 | | | | |
| Plant Category (per subsection 62-699.310(4), F.A.C.): V | | Plant Class (per subsection 62-699.310(4), F.A.C.): D | | |
| Licensed Operators | Name | License Class | License Number | Day(s)/Shift(s) Worked |
| Lead/Chief Operator: | T. Felton | C | 0002241 | Varies |
| Other Operators: | D. Harris | A | 0014540 | Varies |
| | K. Ramsood | C | 0015224 | Varies |
| | T. Levi | C | 0012911 | Varies |
| | M. McNealy | C | 0021734 | Varies |
| | C. Tanzler | C | 0026255 | Varies |
| | T. Haught | C | 0025043 | Varies |
| | N. Hollis, Jr. | B | 0013374 | Varies |

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date:  1 Nov 2023
 Printed or Typed Name: Thomas M. Felton

RECEIVED
 NOV 09 2023 License Number 0002241

DEP Central District

PWS Identification Number: 3354969

Plant Name: Colina Bay

III. Daily Data for the Month/Year of **Oct** / **2023**

Means of Achieving Four-Log Virus Inactivation/Removal: * Free Chlorine Chlorine Dioxide Ozone Combined Chlorine (Chloramines)
 Ultraviolet Radiation Other (Describe):

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine Combined Chlorine (Chloramines) Chlorine Dioxide

| Day of the Month | Days Plant Staffed or Visited by Operator (v) | Hours Plant in Operation | Net Quantity of Finished Water Produced, gal | Peak Flow Rate, gpd | Lowest CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable* | | | | | | | | Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L | Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation |
|------------------|---|--------------------------|--|---------------------|---|---|------------------|----------------------------|-------------------------------|--|--|-----|---|--|
| | | | | | CT Calculations | | | | | UV Dose | | | | |
| | | | | | Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes | Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L | Temp of Water °C | PH of Water, if Applicable | Minimum CT Required, mg-min/L | Lowest Operating UV Dose, mW-sec/cm ² | Minimum UV Dose Required, mW-sec/cm ² | | | |
| 1 | | 24 | 32000 | | | | | | | | | | | |
| 2 | v | 24 | 32000 | | | | | | | | | 0.8 | | |
| 3 | | 24 | 25000 | | | | | | | | | | | |
| 4 | v | 24 | 24000 | | | | | | | | | 0.6 | | |
| 5 | | 24 | 25000 | | | | | | | | | | | |
| 6 | v | 24 | 26000 | | | | | | | | | 1.0 | | |
| 7 | | 24 | 25000 | | | | | | | | | | | |
| 8 | | 24 | 25000 | | | | | | | | | | | |
| 9 | v | 24 | 24000 | | | | | | | | | 0.8 | | |
| 10 | | 24 | 27000 | | | | | | | | | | | |
| 11 | v | 24 | 27000 | | | | | | | | | 0.7 | | |
| 12 | | 24 | 25000 | | | | | | | | | | | |
| 13 | v | 24 | 24000 | | | | | | | | | 0.7 | | |
| 14 | | 24 | 21000 | | | | | | | | | | | |
| 15 | | 24 | 21000 | | | | | | | | | | | |
| 16 | v | 24 | 21000 | | | | | | | | | 0.9 | | |
| 17 | | 24 | 28000 | | | | | | | | | | | |
| 18 | v | 24 | 28000 | | | | | | | | | 0.7 | | |
| 19 | | 24 | 30000 | | | | | | | | | | | |
| 20 | v | 24 | 29000 | | | | | | | | | 0.8 | | |
| 21 | | 24 | 27000 | | | | | | | | | | | |
| 22 | | 24 | 27000 | | | | | | | | | | | |
| 23 | v | 24 | 27000 | | | | | | | | | 0.9 | BT | |
| 24 | | 24 | 37000 | | | | | | | | | | | |
| 25 | v | 24 | 38000 | | | | | | | | | 1.0 | | |
| 26 | | 24 | 34000 | | | | | | | | | | | |
| 27 | v | 24 | 34000 | | | | | | | | | 1.0 | | |
| 28 | | 24 | 28000 | | | | | | | | | | | |
| 29 | | 24 | 28000 | | | | | | | | | | | |
| 30 | v | 24 | 29000 | | | | | | | | | 1.0 | | |
| 31 | | 24 | 25000 | | | | | | | | | | | |
| Total | | | 853000 | | | | | | | | | | | |
| Average | | | 27516 | | | | | | | | | | | |
| Maximum | | | 38000 | | | | | | | | | | | |

* Refer to the instructions for this report to determine which plants must provide this information.